

PG 10'
N 4'
PT 3'

45'

PT 5761 SJ CO.
STOCKTON SUB'N. U.I.C.
15,000 VOLTS


R/W NOTE
R/W DEPT. OBTAIN PERMISSION
TO CUT LEVEES.

PERMISSION TO PLACE POLE #1
& BURY CABLE FROM EDGE OF LEVEE
TO POLE #234 OBTAINED FROM DAVID
ZUCKERMAN BY ENGR. 6-20-51

REARRANGE SERVICE DROPS 148-M

LEGEND
PRESENT LINES
EST. ULTIMATE

OUTSIDE S.R.A.

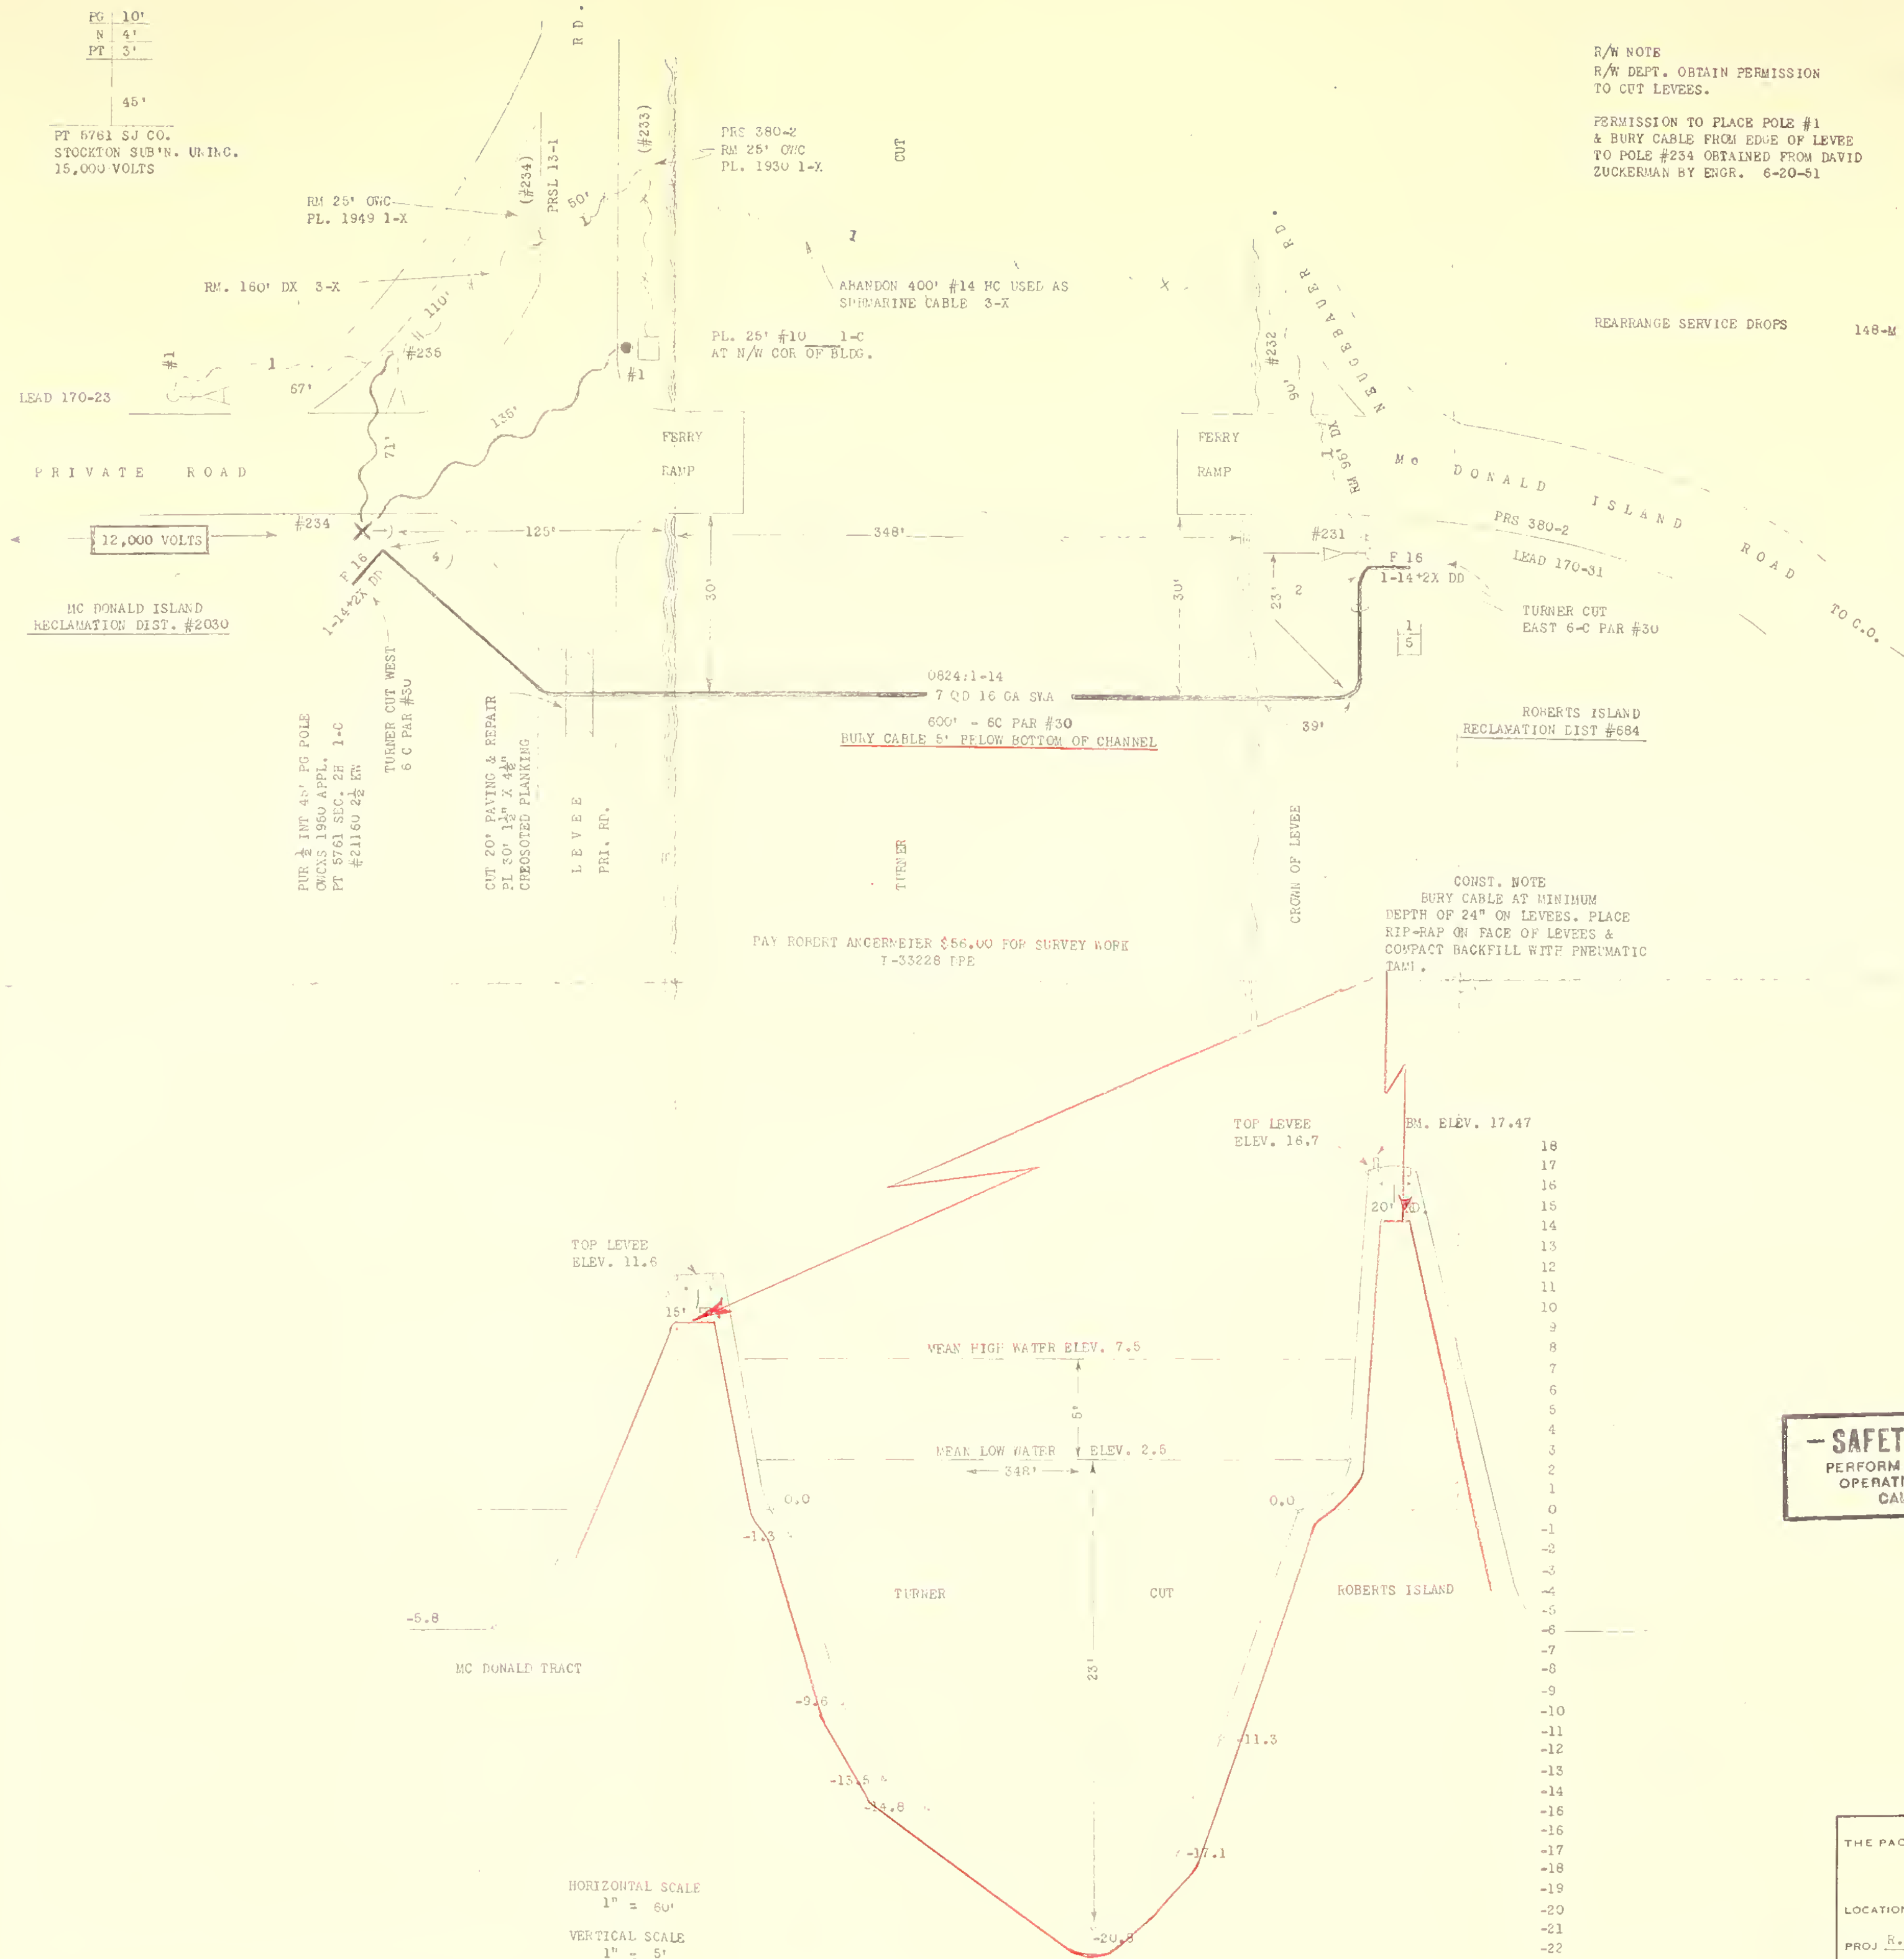



Digitized by the Internet Archive
in 2013

http://archive.org/details/reclamationdistr00paci_0